


	RECESSED INCANDESCENT LIGHT FIXTURE - 277V
	2'X4' FLUORESCENT LIGHT - 277V
	2'X4' FLUORESCENT LIGHT W/PARABOLIC LENS - 277V
	2'X4' FLUORESCENT NIGHT LIGHT - 277V
	2'X2' FLUORESCENT LIGHT - 277V
	2'X2' FLUORESCENT LIGHT W/PARABOLIC LENS - 277V
	8'-0" FLUORESCENT LIGHT FIXTURE
	RETURN AIR GRILLE
	24"x24" SUPPLY AIR DIFFUSER

- | | |
|---|-------------------------|
|  | TOILET ROOM EXHAUST FAN |
|  | EXTERIOR LIGHT |
|  | EXIT SIGN |
|  | EMERGENCY LIGHT |
|  | LIGHT SWITCH |
|  | 110v. ELECTRICAL OUTLET |
|  | FAN MOTOR |
|  | O.H. DOOR MOTOR |
|  | PHONE JACK - VOICE |
|  | PHONE JACK - DATA |



SCALE: 1/16" = 1'-0"

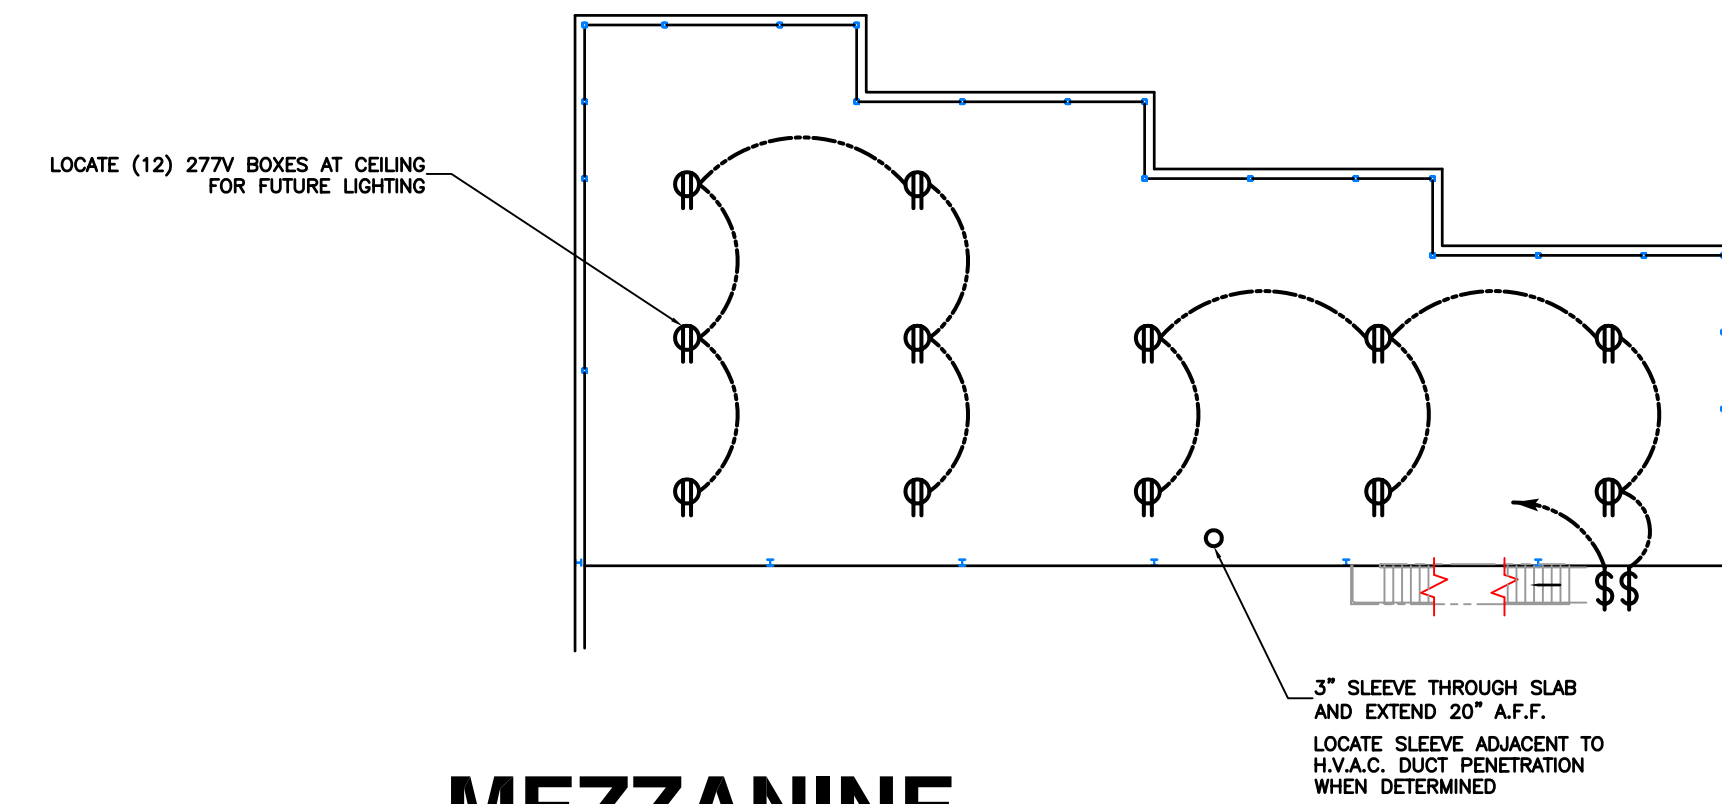

SCALE: 1/4" = 1'-0"

NOTE!
CEILING GRID @ 8'-8" AFF (UNO)

PLEASE NOTE:

THIS DRAWING IS DIAGRAMMATIC AND SHOULD BE USED TO DETERMINE THE DESIGN INTENT. THE CONTRACTOR SHALL FIELD VERIFY ALL WORK AND SHALL NOTIFY THE DESIGNER IMMEDIATELY OF ANY DISCREPANCIES IN THE DOCUMENTS BEFORE PROCEEDING. FAILURE TO DO SO WILL RESULT IN THE CONTRACTOR TAKING ALL RESPONSIBILITY AND LIABILITY IN SAID DISCREPANCIES.

A R Decker & Associates
Consulting Engineers
Civil — Structural
906 East Long Lake Road
Troy, Michigan 48098
Telephone (248) 528-3779
Facsimile (248) 528-3548

CLIENT

R. BURGETT

ODESSA BUILDERS

45000 RIVER RIDGE DR
RIVER RIDGE CORP. CENTRE
CLINTON TWP., MI 48038
(810) 416-4500
(810) 226-5666

PROJECT TITLE	"CAP 2 " SPEC. BLDG. EAST POINTE INDUSTRIAL PARK LOT #2 24201 CAPITAL BLVD CLINTON TWP., MI 48036
---------------	--

SHEET TITLE

OFFICE LIGHT& ELECTRIC
POLYMER PROCESS
DEVELOPMENT

[illegible]

SEAL

SHEET NO.
E-2.1

PROJECT NO.
97342